

# **USER'S MANUAL**

## **MPNC030-01 series**

### **4 analog inputs**



Via Enrico Fermi, 57/59 - 10091 ALPIGNANO (TO)  
☎ Telefono: +39 (0)11 9664616 Fax: +39 (0)11 9664610  
E-mail: [srlmect@mect.it](mailto:srlmect@mect.it) - C.F. e P.I. 04056380019

ME7016\_07  
03/20



**INDEX**

INDEX..... 1

1.0 Introduction ..... 2

    1.1 Staff skill..... 2

    1.2 Symbols ..... 2

    1.3 Glossary ..... 2

    1.4 Security ..... 3

2.0 MPNC System..... 3

    2.1 System Description..... 3

    2.2 NORMS ..... 3

    2.3 Technical Data..... 4

    2.4 Installation ..... 5

        2.4.1 Distances ..... 5

        2.4.2 Component Adding and Removal ..... 6

        2.4.3 Assembly sequence..... 6

        2.4.4 DIN Rail and TBUS..... 7

        2.4.5 Wiring Description ..... 7

        2.4.6 Connections for each input ..... 8

    2.5 LED..... 9

## 1.0 Introduction

To ensure fast installation and commissioning of described devices, we recommend that you carefully read the information in this manual.

### 1.1 Staff skill

The products described in this manual are for use only by personnel with experience in PLC programming, or technical specialist in the use of an electrical-driven automation.

MECT Srl is not liable for failures caused by improper usage and damage to MECT devices or other devices, due to the non-compliance to the instructions contained in this manual.

MECT Srl offers technical assistance through its technical office.

### 1.2 Symbols



#### **Danger**

Adhere to instruction to avoid damages to people or devices.

---



#### **Warning**

To protect the device adhere to instructions .

---



#### **Attention**

Conditions to be met for an effective installation

---



#### **ESD (Electrostatic Discharge)**

Attention: possible component damage due to electrostatic discharge.

---



#### **Note**

Correct installation step

---



#### **Further Information**

---

### 1.3 Glossary

Coupler: MPNC006 or MPNC010

Terminals: MPNC020 for digital input/output; MPNC030 for analog inputs; MPNC035 for analog outputs

System: coupler together with Terminals.

TBUS: internal communication bus between Coupler and terminals.

## 1.4 Security



### Attention

Power down devices before any operation.



### Attention

MPNC030 must be installed in closets or cabinets accessible only by qualified personnel through a key or a tool.



### ESD (Electrostatic Discharge)

The modules contain electronic components that can be destroyed by electrostatic discharge. Every time you handle the modules, be sure that you and the system are connected to ground.

The device does not have an ON-OFF switch and an internal fuse. Power up occurs after applying the correct voltage (please check the power source voltage indicated on the nameplate of the device under "Power"). Provide a supply line as direct as possible and separated from the line that supplies high power components. For safety, you must provide a two-phase disconnecting switch with fuse located near the device and easily accessible by the operator. Do not allow in the same power panel high power devices (contactors, motors, drives, ect.), or excessive moisture, heat and corrosive gases. The devices must be powered by an instrument transformer or by a SELV power supply.

## 2.0 MPNC System

### 2.1 System Description

#### System composed of coupler (MPNC010) or (MPNC006)

MPNC is a modular system made by a coupler/controller (MPNC010 or MPNC006) and a set of terminals for different kind of signals (MPNC020; MPNC030 ...). The coupler is a CANopen interface in the MPNC010 version and Modbus interface in the MPNC006 version, also processes data from the terminals and makes them available to the fieldbus. The coupler can be connected to both analog and digital Terminals.

### 2.2 NORMS

Reference standards are listed in the CE conformity declaration on the Mect web site.

**2.3 Technical Data**

<b>Mechanic</b>	
Material	Polycarbonate, Polyamide 6.6
Dimensions W x H x L - Terminal	- 22.5 mm x 108 mm x 115 mm
Power supply	24Vdc $\pm$ 15%
Installation	DIN 35
<b>Climatic Environmental Condition</b>	
Operative Temperature	0 °C ... 55 °C
Storage Temperature	-20 °C ... +85 °C
Relative Humidity	5 % to 95 % without condensation
<b>Safe Electrical Insulation</b>	
Air and creepage distance	acc. to IEC 60664-1
Degree of Pollution acc. o IEC 61131-2	2
<b>Degree of Protection</b>	
Degree of Protection	IP 20

<b>MPNC030 01</b>		
Max Power Dissipation	0.8 W excluding power to loads	
Input	0÷20mA: 0 ÷ 20000 0 ÷10V: 0 ÷ 10000 PT100E: -40 ÷ +800 °C PT100R: -40.0 ÷ +200.0 °C T/C J : 0 ÷ +600 °C T/C K : 0 ÷ +1200 °C T/C T : 0 ÷ +400 °C	Input Impedance: 9 ohm Input Impedance: 1Mohm
Resolution	12 bit	
Precision	0,5%	
Thermal Stability	50ppm/°C	

**Attention**

Install devices in power panel with temperature lower than 55°C

Dimensions

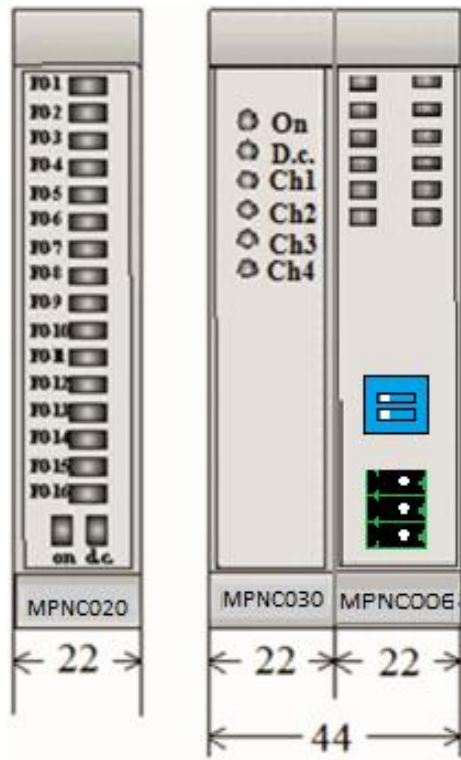


Fig 1: Dimensions

2.4 Installation

2.4.1 Distances

The system must be installed allowing enough space for heat transfer, installation and wiring. Avoiding wires overlapping also prevents electromagnetic compatibility problems.

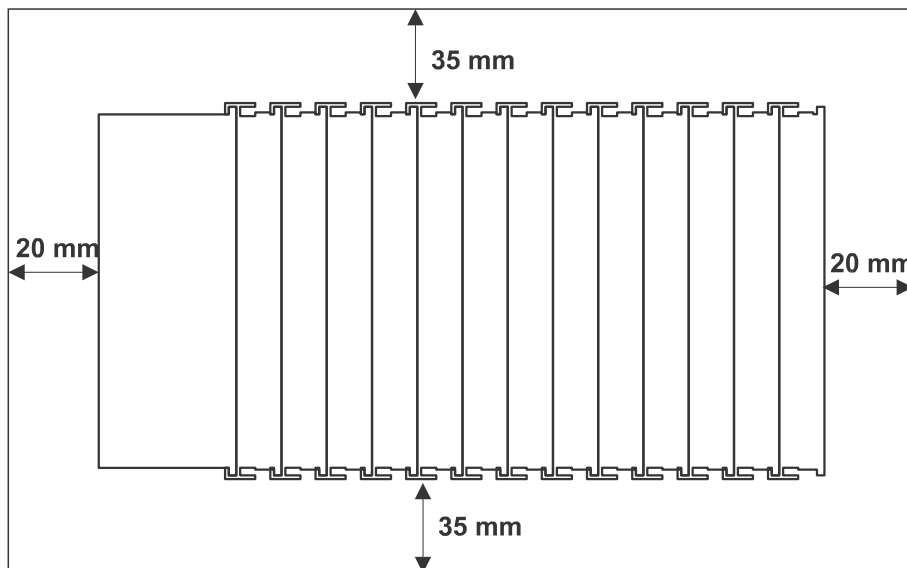


Fig 2: Spaces

### 2.4.2 Component Adding and Removal



**Attention**

Be sure that devices are not powered when performing component adding or removal.

### 2.4.3 Assembly sequence

The insertion and removal of a terminal is made by using the hook at the base of the terminal as shown.

The assembly must begin with the insertion of the coupler (MPNC010 or MPNC006). After that, the required terminal are inserted in sequence. The DIN rail mounting is ensured by the spring coupling each terminal.

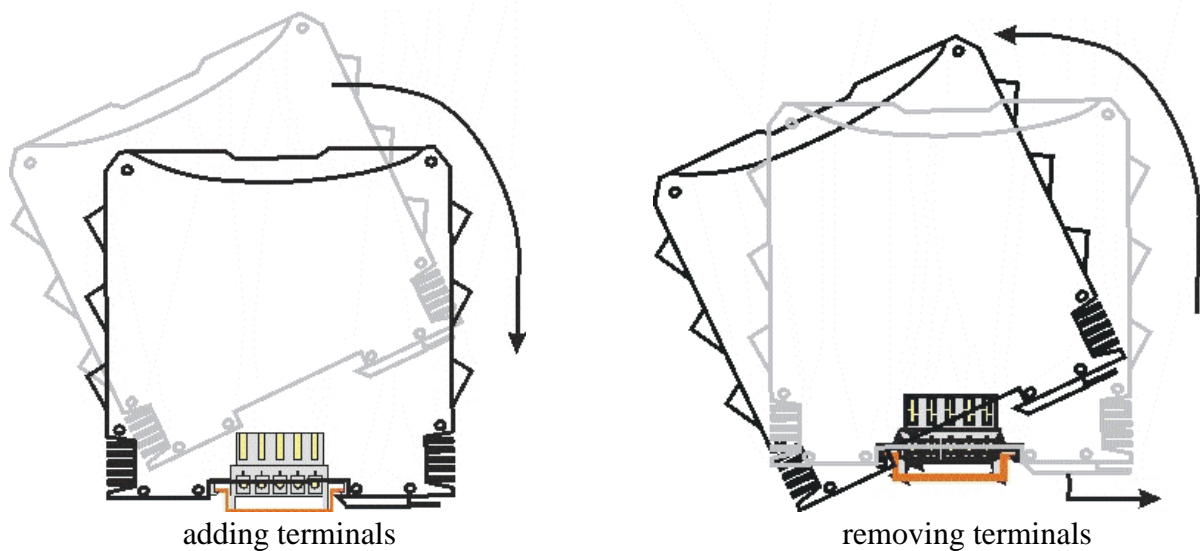


Fig 3: Terminal adding and removal

The instruments must be assembled on TBUS as shown below. MPNC010 or MPNC006 must be positioned to the right and the nodes to the left.

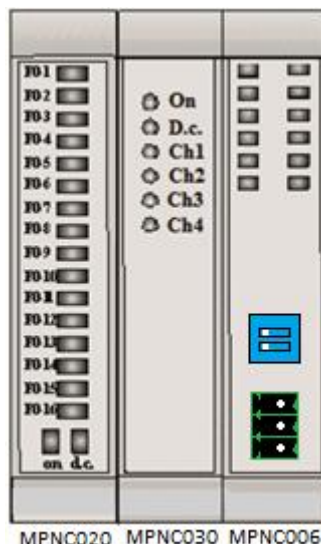


Fig 4: Assembly



### 2.4.4 DIN Rail and TBUS

All modules must be attached directly onto a DIN rail type EN 50022 (DIN 35) on which their TBUS connection modules were inserted. TBUS connection modules perform internal communication between the bus coupler and terminals.

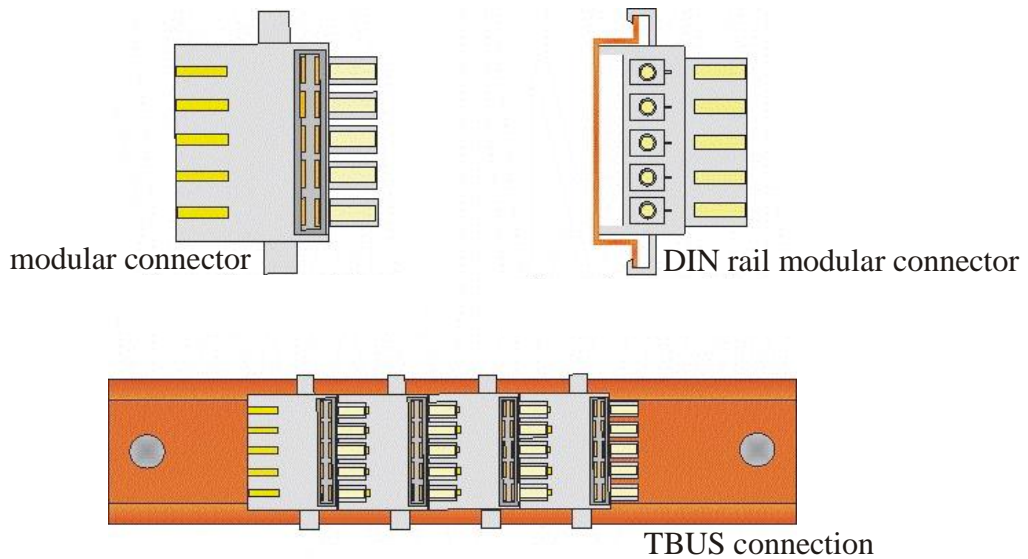


Fig 5: TBUS

### 2.4.5 Wiring Description

MPNC006 and nodes daisy chain connection

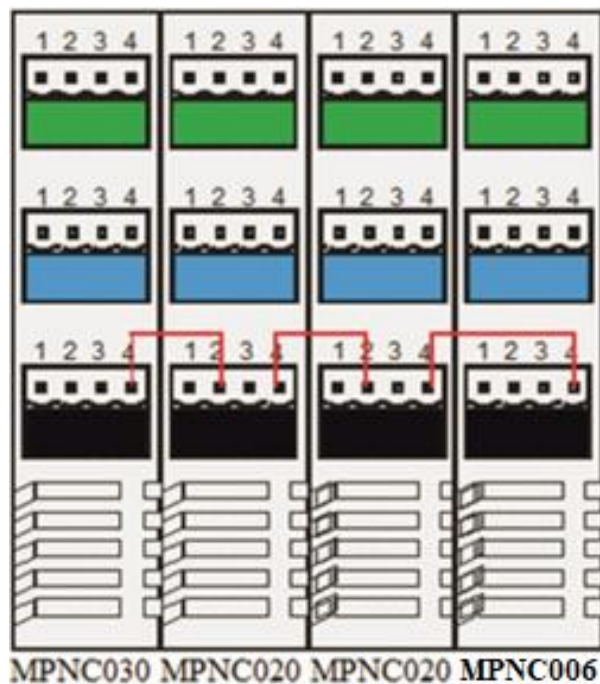


Fig 6: Daisy chain MPNC006

# Analog inputs module: MPNC030-01

Mect srl


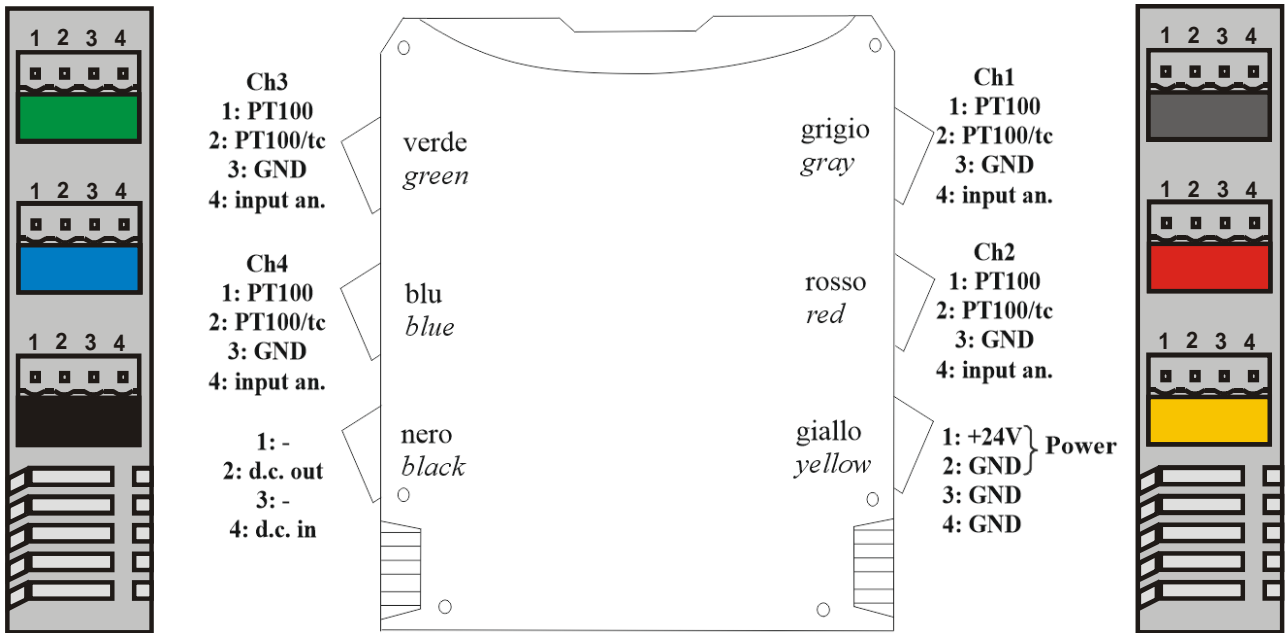



Fig 8: Signals connection

## 2.4.6 Connections for each input


Thermocoupling input connection




Pt100 connection



4-20mA, 0-10V connection

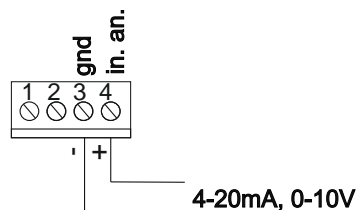

2.5 LED

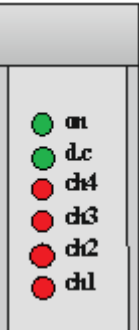	LE D	Status	Description
	On	Blinking	Terminal not configured
	On	On	Terminal configured
	Off	Off	Terminal not powered
	d.c	Off	Terminal is in reset state Cause: <ul style="list-style-type: none"> <li>• daisy chain non is not connected</li> <li>• terminale is not powered</li> </ul>
	On		daisy chain IN is correctly connected
	Ch4	Off	Function OK
		Blinking	The input is over range (e.g. open probe in case of thermometric inputs)
	Ch3	Off	Function OK
		Blinking	The input is over range (e.g. open probe in case of thermometric inputs)
	Ch2	Off	Function OK
		Blinking	The input is over range (e.g. open probe in case of thermometric inputs)
	Ch1	Off	Function OK
		Blinking	The input is over range (e.g. open probe in case of thermometric inputs)